



BLDG. 84 PARTIAL FIRST FLOOR PLAN-ROOM 107
SCALE: 1"=1'-0"

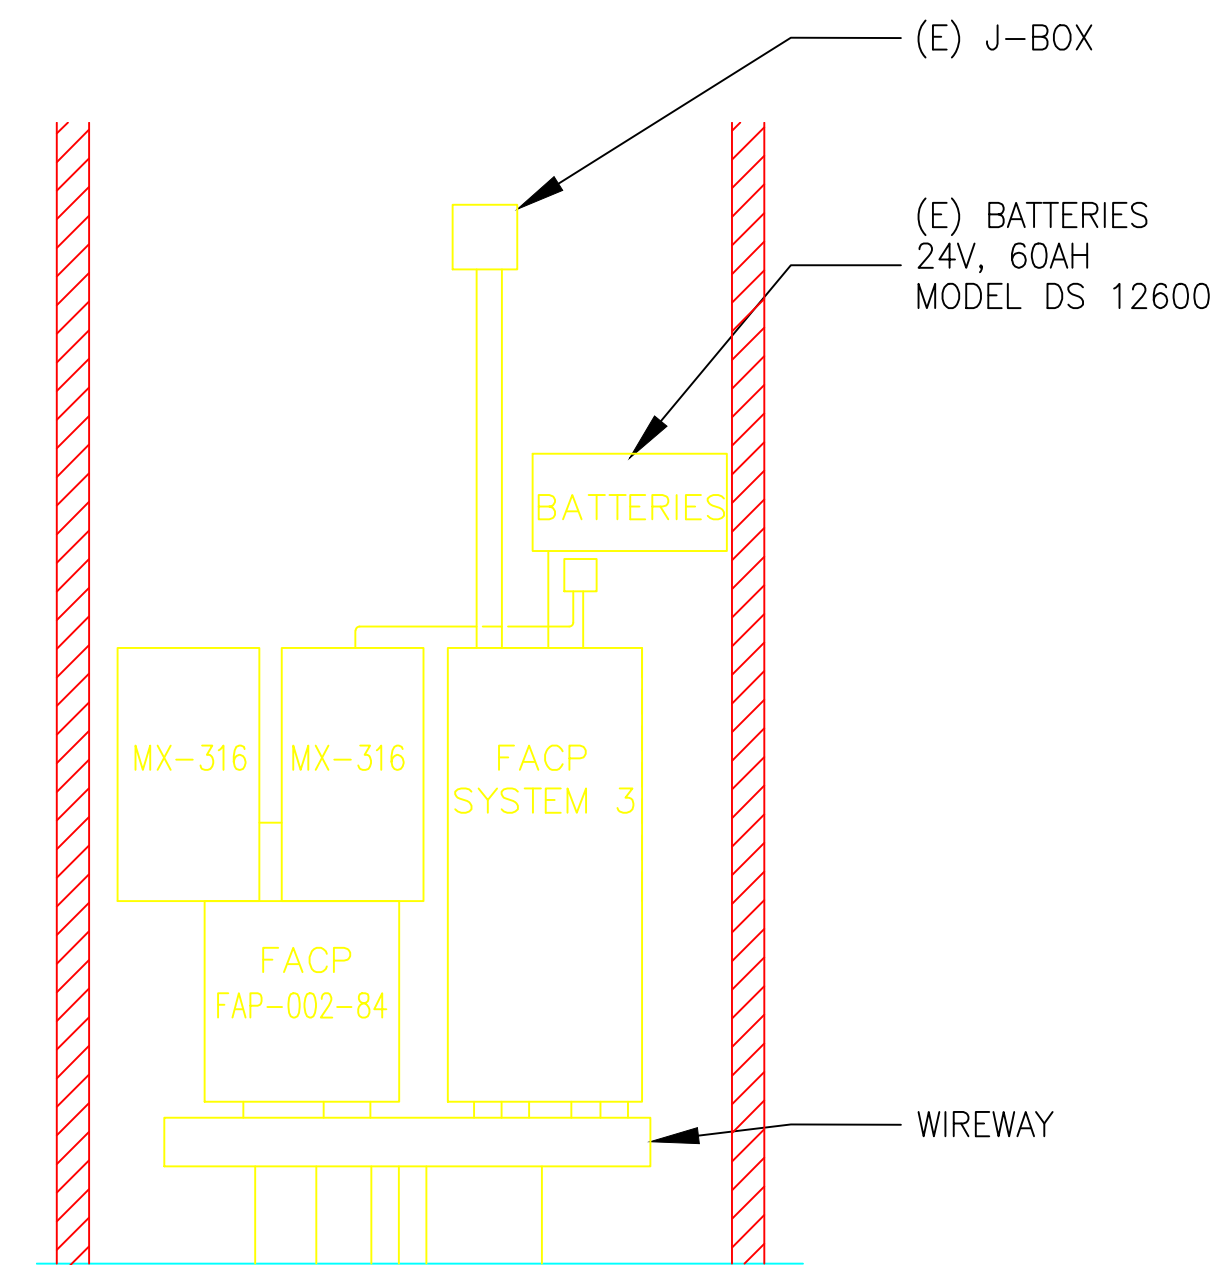

SECTION
SCALE: 1/2"=1'-0"

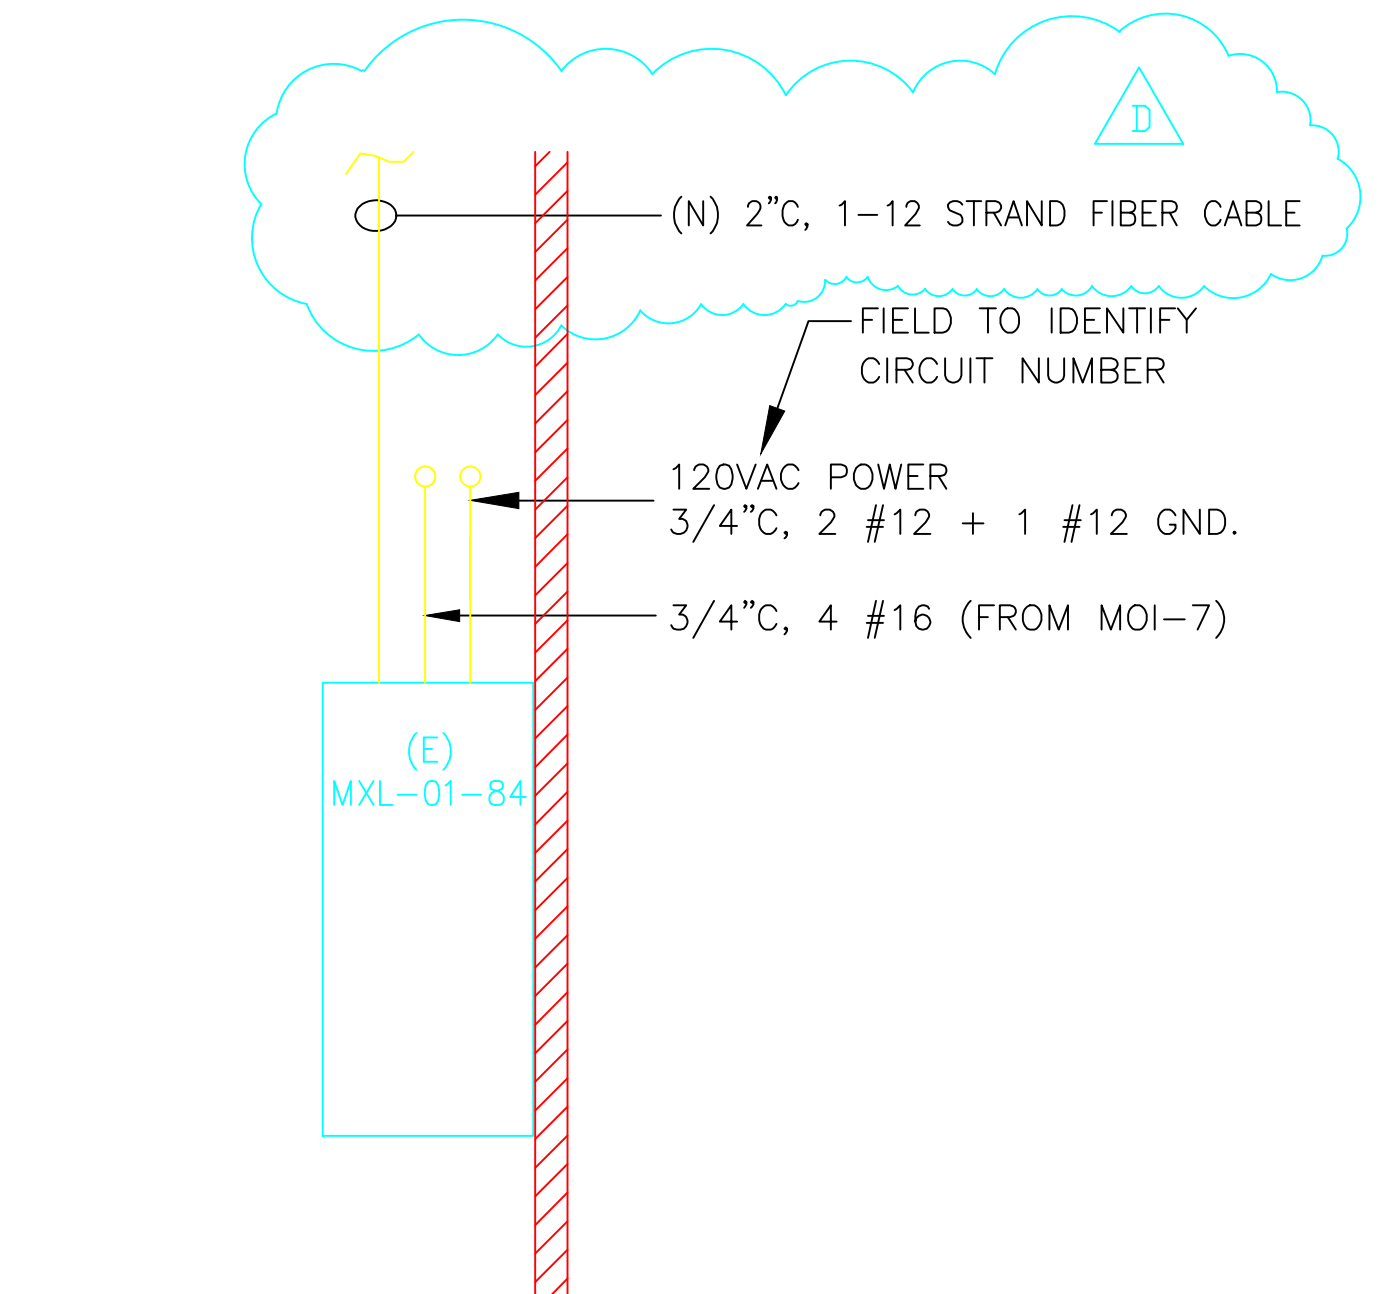

SECTION
SCALE: NONE

LEGEND:

- (E) EXISTING
(N) NEW
② SMOKE DETECTOR-IONIZATION
1

CONSTRUCTION NOTES:



1. "NTD" TO GET 4PR #18 AWG CABLES FROM ELECTRIC SHOP AND INSTALL WITH 1-12 STRAND FIBER CABLE. LEAVE 15 FEET OF COILED CABLES AT "FACP" END.

PROFESSIONAL SEAL (IF REVISION, APPLIES ONLY TO REVISED WORK)	TITLE 2 CONSTRUCTION A 8/14/2003								84 FIRE ALARM FIRST FLOOR ROOM 107 PARTIAL PLAN & SECTIONS		DRAWN BY	MRC	DATE	8/13/2003
											CHECKED BY	AD		8/13/2003
											APPROVED BY	MCG		8/15/2003
											CAD FILE PATH 00018998		SCALE As Noted	
											DRAWING NO.	4B84E127A	SHEET	
		ISSUE (PROGRESS, ESTIMATE, BID, CONSTRUCTION, CONFORMED, REVISION, RECORD)	REVISION NUMBER	DRAWN BY	CHECKED BY	APPR'D BY	DATE	REMARKS	UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY FACILITIES DIVISION		PROJECT NO. WG0721		1 OF 1	
			A	IPM	MCG	MCG	02/22/03	ADDED CONDUIT FOR FIBER CABLE (FE5012)						